



Northern Hills  
Source Water Protection  
Plan

Stephenson County, IL  
June 2024

---

**ENGINEERING ENTERPRISES, INC.**



# SOURCE WATER PROTECTION PLAN

## Prairie Path Water Company – Northern Hills

### TABLE OF CONTENTS

<u>SECTION</u>	<u>PAGE NO.</u>
1.0 INTRODUCTION.....	1-1
1.1 Background .....	1-1
2.0 VISION STATEMENT .....	2-1
2.1 Policy and Commitment to Protecting Source Water .....	2-1
2.2 Reasons to Protect Source Water .....	2-1
2.3 Barriers to Protecting Source Water .....	2-2
2.4 Names of the Individuals Who Developed the Vision Statement .....	2-3
3.0 SOURCE WATER ASSESSMENT .....	3-1
3.1 Statement of the Importance of Source Water .....	3-1
3.2 List of Water Supplies that Obtain Water from the Community Water Supply ...	3-2
3.3 Delineation of all Sources of Water Used by the Community Water Supply .....	3-2
3.4 Report on the Quality of the Source Water for All Sources of Water.....	3-4
3.5 Report on the Quality of the Finished Water .....	3-6
3.6 Identification of Potential Sources of Contamination to the Source Water .....	3-9
3.7 Analysis of the Source Water's Susceptibility to Contamination .....	3-10
3.8 Explanation of the Community Water Supply's Efforts to Protect Its Source Water .....	3-12
4.0 SOURCE WATER PROTECTION PLAN OBJECTIVES.....	4-1
4.1 Identified Concerns .....	4-1
4.2 Objectives.....	4-1
5.0 ACTION PLAN .....	5-1
5.1 Projects, Programs, and Activities to Meet Objectives .....	5-1
5.2 Schedule for Implementing Projects, Programs, and Activities .....	5-1
5.3 Identification of Necessary Resources to Implement the Plan .....	5-1
5.4 Identification of Potential Problems and Obstacles in Implementing the Plan....	5-2

### Tables

3-1	Water Supply Well Information.....	3-3
3-2	Source Water Quality Summary.....	3-5
3-3	Finished Water Quality Summary .....	3-8
3-4	Potential Contaminant Source Inventory.....	3-14
5-1	Source Water Protection Plan Schedule.....	5-3 and 5-4

### Exhibits

1-1	Northern Hills Municipal Boundary and Water Supply Wells.....	1-2
3-1	Northern Hills Municipal Boundary and Water Supply Wells.....	3-3
3-2	Barium Concentration Trend .....	3-6
3-3	Map of Potential Sources of Contamination .....	3-10
3-4	Groundwater Susceptibility .....	3-11

### Appendices

Appendix A.....	Source Water Protection Plan Regulations
Appendix B.....	Well Information
Appendix C .....	Representative Source Water Quality Analytical Reports

## SECTION 1: INTRODUCTION

Prairie Path Water Company (PPWC) owns and operates the Northern Hills Community Water System (CWS) (IL1775050) according to the rules and regulations of the State of Illinois. On July 26, 2019, the Illinois Pollution Control Board passed new and updated regulations for community water systems including Illinois Administrative Code Title 35, Subpart 604, Subpart C - Source Water Protection Plan. The purpose of this new requirement is to facilitate protection of source water quality and quantity throughout the State. It requires each community water supply that treats surface or groundwater as a primary or emergency supply of water to develop a Source Water Protection Plan (SWPP). The SWPP must contain the following minimum elements:

- a) a vision statement;
- b) a source water assessment;
- c) the objectives; and
- d) an action plan.

The specific requirements for each of the elements list above are contained in the regulation, which is included herein as Appendix A. This report is submitted to the Illinois Environmental Protection Agency (IEPA) in fulfillment of the Northern Hills CWS's requirement under Subpart C – Source Water Protection Plan.


### 1.1 Background

The Northern Hills CWS is in Harlem Township, Stephenson County (Exhibit 1-1). The CWS is comprised of a network of various supply, treatment, storage, distribution, and control components. The water system components are specifically designed and operated to provide safe, reliable, and affordable drinking water to the Northern Hills CWS water customers. The existing supply consists of two shallow-medium bedrock wells designated Well 1 and Well 2. Both Wells 1 and 2 are cased off through the sand and gravel and uppermost shallow bedrock geologic layers. Well 1 primarily draws from the Ancell group Galena Sandstone and Platteville Limestone aquifers, and Well 2 additionally draws from the Ordovician system limestone and Silurian-Dolomite aquifer groups in Stephenson County.

The pumped water from Wells 1 and 2 flow to Northern Hills CWS's Water Treatment Plant (TP01). The raw groundwater is then treated chemically with sodium hypochlorite for bacterial disinfection, fluoridation for dental benefits, and AQUA MAG phosphate blend for corrosion inhibition and metal ion sequestration in the distribution system. The water from Wells 1 and 2 are treated to meet drinking water quality standards and is then distributed to Northern Hills CWS's residential service population of 600 delivered through 171 residential water service connections.

The effectiveness of the system depends on the availability and quality of the water used as the source of water (source water). Significant changes in source water availability or quality often require costly modifications to the water system. Therefore, the Northern Hills CWS benefits from Source Water Protection because the program can reduce the risk of source water impairment.

**Exhibit 1-1: Northern Hills CWS Location Map**

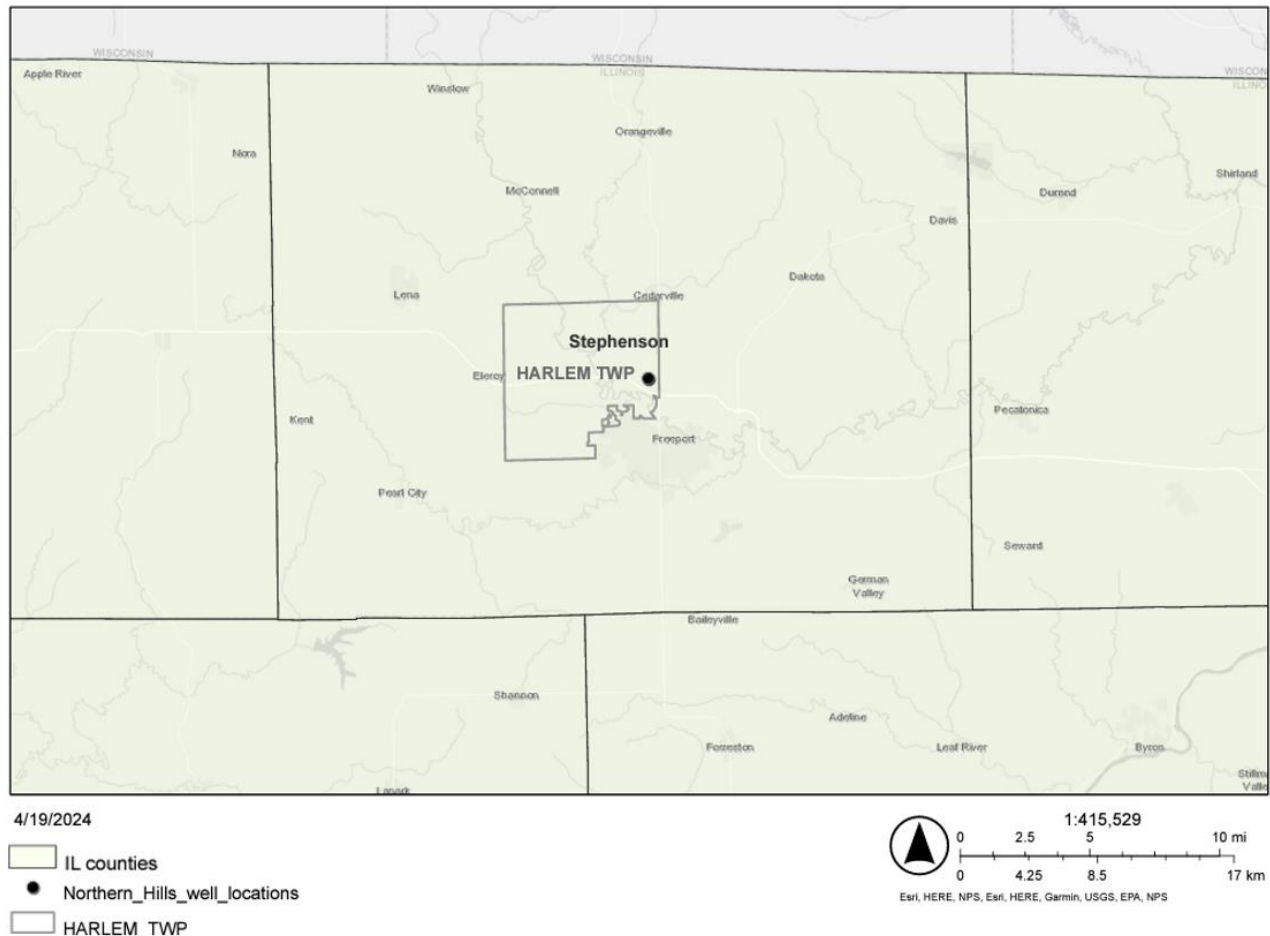

## SECTION 2: VISION STATEMENT

This section presents the System's adherence to the requirements of Section 604.310 Vision Statement, which are:

*The vision statement must include the following:*

- a) the community water supply's policy and commitment to protecting source water;*
- b) an explanation of the community water supply's resources to protect source water;*
- c) an explanation of the barriers to protecting source water; and*
- d) the names of the individuals who developed the vision statement.*

### 2.1 Policy and Commitment to Protecting Source Water

The Prairie Path Water Company - Northern Hills CWS policy and commitment to protect source water begins with the following vision statement:

*Prairie Path Water Company is committed to Source Water Protection Programs with the purpose of ensuring the safety, integrity and sustainability of our communities' drinking water, for current and future generations to come, all in an effort to help people enjoy a better life and help communities thrive.*

### 2.2 Resources to Protect Source Water

Prairie Path Water Company commits the following resources to protect the source water of the Northern Hills CWS:

- Human capital and financial resources to protect our source water and to back our commitment to the preservation of safe and sustainable drinking water.
- Staff time and effort to regularly monitor the well supply, monitor changes in potential sources of contamination, and regularly coordinate with local zoning officials to identify future potential sources of contamination.
- Engaging consultants to update the existing source water protection plan to demonstrate the System's commitment to continually improving the plan with updated

information and incorporating lessons learned through experience.

- Development and continual updates to the Northern Hills CWS Emergency Response Plan.

## **2.3 Barriers to Protecting Source Water**

The key to ensuring clean, safe and reliable drinking water is to understand the drinking water supply from the source all the way to the consumer's tap. This knowledge includes understanding the general characteristics of the water and the land surrounding the water source, as well as mapping all the real and potential threats to the water quality. These threats can be natural, such as seasonal droughts or flooding, or created by human activity, such as agriculture, industrial practices, or recreational activities in the watershed. Threats can also arise in the treatment plant or distribution system thanks to operational breakdowns or aging infrastructure.

The multi-barrier approach takes all these threats into account and makes sure there are "barriers" in place to either eliminate them or minimize their impact. It includes selecting the best available source (e.g., lake, river, aquifer) and protecting it from contamination, using effective water treatment, and preventing water quality deterioration in the distribution system. The approach recognizes that while each individual barrier may not be able to completely remove or prevent contamination, and therefore protect public health, together the barriers work to provide greater assurance that the water will be safe to drink over the long term.

By placing integrated barriers from the source to the consumer at the tap, the Northern Hills CWS helps protect the population it serves from the risk of contamination and waterborne disease. The System's multiple barrier approach includes:

- Source Water Protection - delineation of areas that contribute groundwater to the water supply wells, inventory of existing and future threats also referred to as potential sources of contamination, and management of activities in and around the recharge areas of wells.
- Treatment Systems – disinfection to eliminate pathogens that are responsible for waterborne diseases.

- Distribution Systems – maintaining adequate pressure within the water distribution system to prohibit inflow of non-potable water, controlling pressure during water main breaks using water system valving, conducting water main repairs quickly, and properly disinfecting water mains before they are placed back into service.
- Monitoring programs - 24-hour a day monitoring of the water system using a customized Supervisory Control and Data Acquisition (SCADA) system, frequently collecting, and analyzing water samples, security fencing, and visual inspections of operating facilities.
- Well security – PPWC wellheads are located within locked well houses and or gated off areas to protect from vandalism or intentional contamination efforts.
- Operational Response – maintaining an emergency response plan, employing certified operators with proper training and experience to operate the water system, commitment of the organization to continuous improvement, and the assistance of outside experts as needed.

## **2.4 Names of the Individuals Who Developed the Vision Statement**

The names of the individuals who developed the Vision Statement are as follows:

- Justin Kersey, PPWC President
- Mike Miller, PPWC Vice-President of Operations
- David Hankins, PPWC Safety and Compliance Manager
- Kyle Woodworth, PPWC Area Manager
- Tim Holdeman, Engineering Enterprises, Inc.
- Sydney Shaffer, Engineering Enterprises, Inc.
- Jeniece Neville, Engineering Enterprises, Inc.



### SECTION 3: SOURCE WATER ASSESSMENT

This section presents the System's adherence to the requirements of Section 604.315 Source Water Assessment, which are:

- a) *The source water assessment must contain the following information:*
  - 1) *statement of the importance of the source water;*
  - 2) *a list of water supplies that obtain water from this community water supply;*
  - 3) *delineation of all sources of water used by the community water supply, including:*
    - A) *for surface water, description of the watershed, map of the watershed, and intake locations;*
    - B) *for groundwater, the well identification number, well description, well status and well depth; a description of setback zones, and a description of the aquifer for each well;*
  - 4) *a report on the quality of the source water for all sources of water delineated in subsection (a)(3), including:*
    - A) *when and where samples used to determine the quality of the source water were taken. These samples must be tested by a certified laboratory; and*
    - B) *the certified laboratory's results;*
  - 5) *a report on the quality of the finished water;*
  - 6) *identification of potential sources of contamination to the source water;*
  - 7) *analysis of the source water's susceptibility to contamination; and*
  - 8) *explanation of the community water supply's efforts to protect its source water.*

#### 3.1 Statement of the Importance of Source Water

The importance of source water can be conveyed by the importance water plays in the communities it serves. The Northern Hills CWS provides water to several residential sites. The Galena-Platteville and Silurian-Dolomite aquifers are the primary sources of this water. The Northern Hills CWS utilizes two (2) active community water supply wells. The system's water supply wells provides an average of 35,044 gallons per day to a population of approximately 600 people (171 service connections) based on the 2020 Census data. Prairie Path Water Company recognizes that no community can exist without a safe, reliable source of drinking water, and protection of that source water is of the utmost importance.

### **3.2 List of Water Supplies that Obtain Water from the Community Water Supply**

The Northern Hills CWS currently does not supply water to any Community Water Supplies.

### **3.3 Delineation of all Sources of Water Used by the Community Water Supply**

The Northern Hills CWS operates two (2) groundwater wells (Wells 1 and 2). A map showing the location of the water utility service area and water supply wells is shown as Exhibit 3-1. Key information about the wells is listed in Table 3-1, including information required by the SWPP regulation and additional information. Additional well information is included in Appendix B.


The Illinois Groundwater Protection Act (IGPA) in its first phase established setback zones to prohibit the siting of potential sources of contamination within a number of feet of the wellhead. The minimum setback zone prohibits the siting of primary or secondary sources within 200 ft of the wellhead for shallow aquifers. An optional maximum setback zone of 1,000 feet is allowed to prohibit primary sources of contamination from being sited between the minimum setback and 1,000 radial feet of the well.

In the second phase, the IGPA established the delineation of a wellhead protection area (WHPA) for wells that draw from unconfined aquifers out to a 5-year time-of-travel boundary, although it is not used in this report.

**Table 3-1: Water Supply Well Information**

INFORMATION REQUIRED BY SWPP REGULATION							ADDITIONAL INFORMATION	
WELL ID NUMBER	WELL NAME	WELL STATUS	WELL DEPTH	CASING LENGTH	MINIMUM SETBACK	AQUIFER	ADDRESS	YEAR DRILLED
WL11885	1	Active	310	100	200	Galena-Platteville	1438 W Fairview Road Freeport, IL 61032	1974
WL01008	2	Active	330	174	200	Galena-Platteville and Silurian- Dolomite	1438 W Fairview Road Freeport, IL 61032	1997

**Exhibit 3-1: Northern Hills CWS Boundary and Water Supply Well**

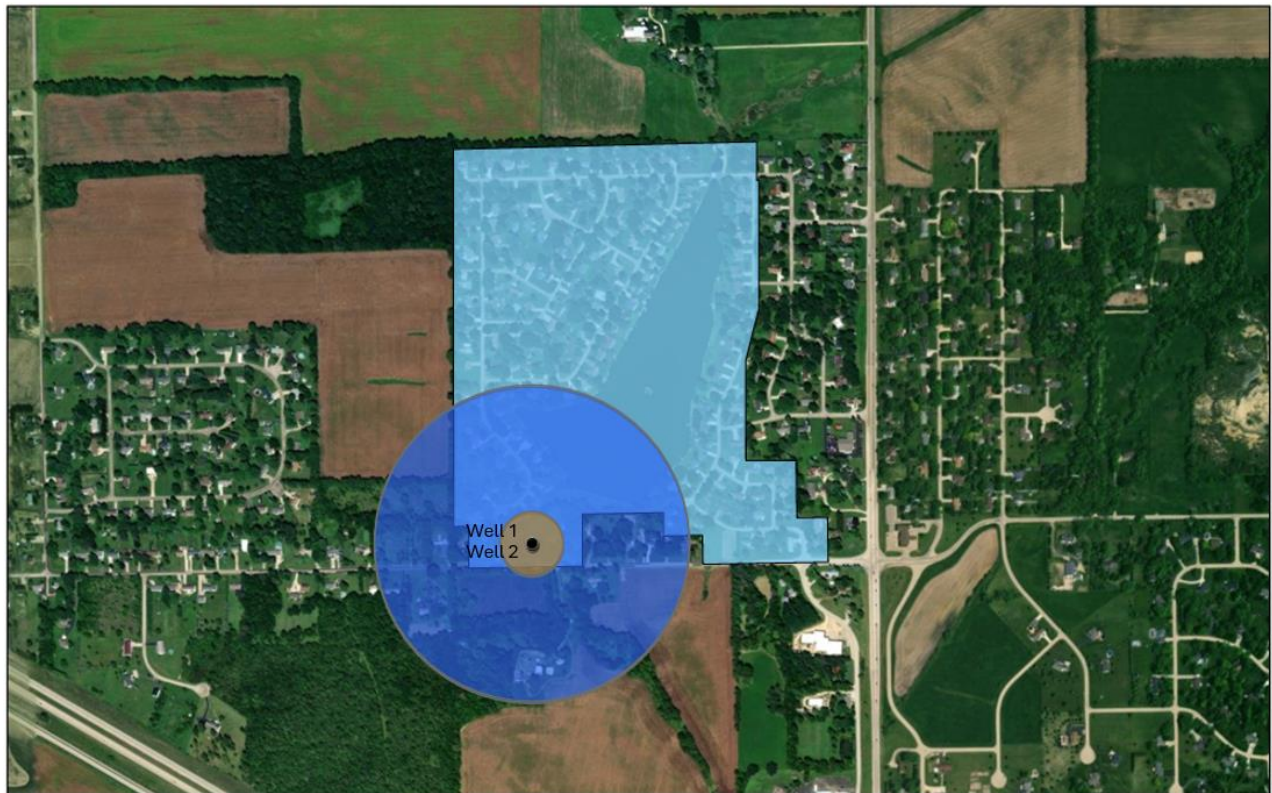

4/19/2024

● Northern\_Hills\_well\_locations  
 200 ft Setback Zone  
 1000 ft Maximum Setback Zone  
 Northern Hills Service Area

0 0.07 0.15 0.3 mi  
 0 0.13 0.25 0.5 km  
 Earthstar Geographics

### 3.4 Report on The Quality of the Source Water for All Sources of Water

An analysis of the quality of groundwater from the Galena-Platteville and Silurian-Dolomite aquifers used by the System as its source water was conducted as part of the Source Water Assessment. Water quality data from groundwater samples from the System's wells collected from 2011 to 2021 is presented in Table 3-2. A select number of analytical results are included in Appendix C.

The concentration of inorganic constituents in the groundwater pumped by the System's wells is summarized and compared to Class 1 Water Quality Standards for Groundwater (35 Ill. Admin. Code Part 620). No inorganic constituents have been reported above the levels set in the Water Quality Standards. All inorganic constituent levels have generally remained at steady levels in sample reports taken between 2013 and 2023. Iron levels have remained steady, ranging between 0.42 mg/L and 0.55 mg/L. The MCL for finished water iron concentrations is 1.0 mg/L, so Northern Hills' iron concentrations still remain sufficiently below the MCL. All organic compounds including the Volatile Organic Compounds (VOCs) and Synthetic Organic Compounds (SOCs) were reported below the detection limits of each testing method.

Exhibit 3-2 is a graph of fluoride concentrations from Wells 1 and 2. The graph shows that fluoride concentrations have risen slightly since 2013 with the latest sample being in February 2023. However, the highest reported level is 0.701 mg/L, which is not near the Standard of 4 mg/L. The presence of fluoride is not considered a violation however because of a stipulation in Part 620.410 of the Illinois Groundwater Quality Standards that indicates no violation can occur as a result of the natural occurrence of an IOC.

**Table 3-2: Source Water Quality Summary**


	Wells		1 and 2 (WL11885, WL01008)	Class 1 GW Qual. Std.
<b>Aquifer</b>	Sand and Gravel			
	Silurian Dolomite			
	Galena-Platteville			
	St. Peter Sandstone			
	Ironton-Galesville Sandstone			
	Eau Claire Sandstone			
	Mt. Simon Sandstone			
<b>Inorganic Compounds</b>	Antimony	(µg/L)	NR	6
	Arsenic	(µg/L)	ND - 1	10
	Barium	(µg/L)	29 - 39.4	2000
	Beryllium	(µg/L)	NR	4
	Boron	(mg/L)	NR	2
	Cadmium	(µg/L)	ND - 1	5
	Chloride	(mg/L)	1.3 - 3.3	200
	Chromium	(µg/L)	ND - 4	100
	Cyanide	(mg/L)	ND - 0.2	0.2
	Fluoride	(mg/L)	0.35 - 0.702	4
	Iron	(mg/L)	0.42 - 0.55	5
	Manganese	(µg/L)	30.4 - 35	150
	Mercury	(µg/L)	ND - 0.2	2
	Nickel	(µg/L)	5 - 7.7	100
	Selenium	(µg/L)	ND - 2	50
	Sodium	(mg/L)	2.12 - 7.2	
	Sulfate	(mg/L)	9.4 - 12	400
	Thallium	(µg/L)	ND	2
	Total Dissolved Solids	(mg/L)	260 - 330	1200
<b>Radiologicals</b>	ALPHA, Gross	pCi/L	NR	
	Radium-226	pCi/L	1.6 - 2.44	20
	Radium-228	pCi/L	0.945	20
	Combined Radium	pCi/L	1.61 - 2.44	
<b>PFAS</b>	PFOA	(ng/L)	ND	4
	PFOS	(ng/L)	ND	4
	SOCS <sup>b</sup>	(µg/L)	ND	
	VOCs <sup>b</sup>	(µg/L)	ND	


**Notes:**

<sup>a</sup> Results from Safe Drinking Water Information System (SDWIS) Lab Sample Numbers GB02680-01, 0012500-01, 19F0606-01, 19F0606-02, 7012874-01, 4100802-01, 4012973-01, 3073776-01, 0012500-01, 4100802-01, 0012500-01, 19F0606-01, 19F0606-02, 4100802-01, 4012973-01, EA00610-01, 30138537001, 30131410001


NR = No Record  
 ND = Non Detect

<sup>b</sup> Detailed laboratory results can be found in Appendix C

 Highlighted value indicates raw water concentration exceeds Class 1 Groundwater Quality Standards. In all cases, treatment is in place to reduce concentration below the standard, and routine monitoring is required.

 Highlighted value indicates raw water concentration for parameter that may be approaching the Groundwater Quality Standard or may cause water quality issues. In some cases, treatment is in place to reduce concentration below the standard, and routine monitoring is recommended.

**Exhibit 3-2: Selenium Concentration Trend**

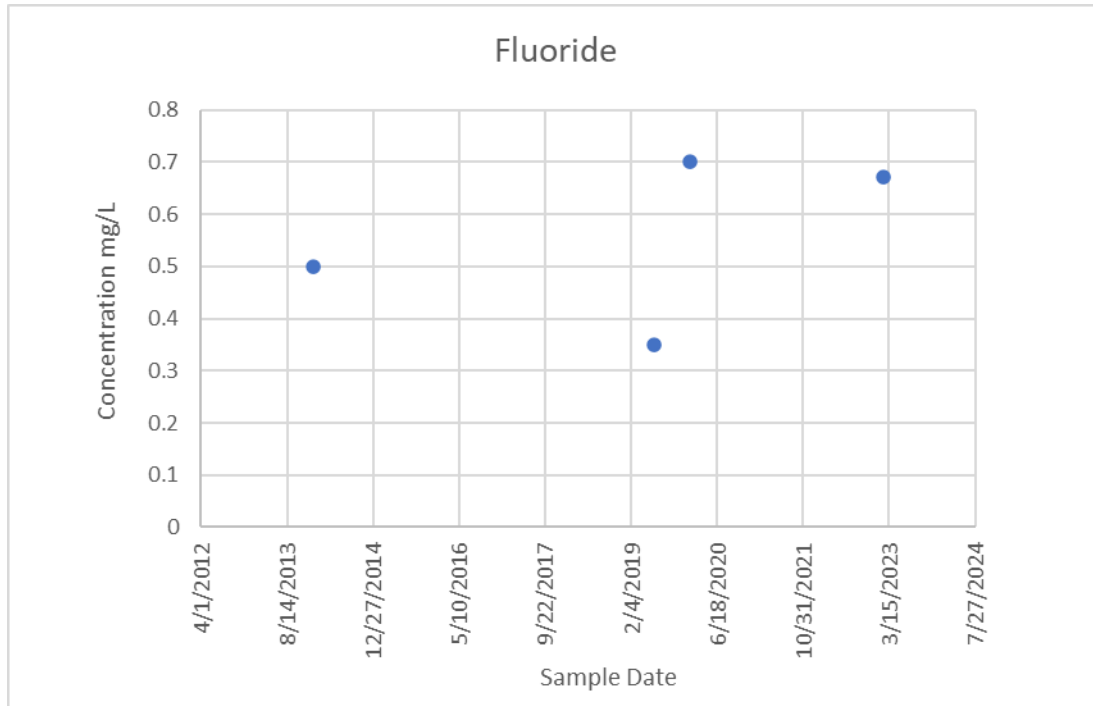

### 3.5 Report on the Quality of the Finished Water

An analysis of Northern Hills’s finished water was conducted as part of the Source Water Assessment. Table 3-3 presents a summary of the System’s finished water quality based on analytical results from 2019 to 2023. Based on the water quality sampling results shown in Table 3-3, the System’s finished water does not exceed any primary maximum contaminant levels (MCLs). Lead and copper levels are near the MCLs, however, these levels are likely not derived from the source water of Northern Hills’ wells, but rather, fixtures within the distribution system.

Shallow aquifers in much of Northeastern Illinois are experiencing elevated Per- and Polyfluoroalkyl Substances (PFAS) levels. The IEPA has initiated a statewide testing program to test for and monitor PFAS levels of 18 PFAS compounds in water supplies throughout the state but has not yet set enforceable drinking water standards for these compounds. Rather, it has set a health guidance level for six (6) PFAS compounds. The USEPA has recently finalized MCLs for PFOS and PFOA and four (4) other PFAS compounds, although those will not take effect until 2029. The Northern Hills System has

no detectable PFAS levels in its finished water. The treatment processes applied in the Northern Hills CWS do not remove PFAS compounds, therefore the finished water sample results are representative of PFAS compounds in the source water.

The water quality reports in the form of Consumer Confidence Report can be found on the System's website at: <https://www.myutility.us/prairiepathwater/water-safety/water-quality-reports>.

**Table 3-3: Finished Water Quality Summary**


			Well Effluent <sup>a</sup>	MCLG <sup>b</sup>	MCL <sup>b</sup>
<b>Aquifer</b>	Sand and Gravel				
	Silurian Dolomite				
	Galena-Platteville				
	St. Peter Sandstone				
	Ironton-Galesville Sandstone				
	Eau Claire Sandstone				
	Mt. Simon Sandstone				
<b>IOCs</b>	Copper	ppm	0.385 - 1.055	1.3	1.3
	Lead	ppb	1.3 - 10		15
	Arsenic	ppb	NR		10
	Barium	ppm	0.029 - 0.036	2	2
	Iron	ppm	0.44 - 0.48		1
	Manganese	ppb	2.4 - 2.8	150	150
	Total Nitrate & Nitrite	ppm	NR	10	10
	Nitrate as N	ppm	NR	10	10
	Fluoride	ppm	0.671 - 0.701	4	4
	Sulfate	ppm	NR		
	Selenium	ppb	NR	50	50
	Sodium	ppm	2.2 - 5.7		
	Zinc	ppm	0.019 - 0.022	5	5
<b>Disinfectants</b>	TTHMs	ppb	0.571 - 1.31		80
	HAA5	ppb	0.019		60
	Chlorine as Cl <sub>2</sub>	ppm	0.84 - 1.81	4	4
	TOC	n/a	NR		
<b>Microbials</b>	Turbidity	NTU	NR		1
	Turbidity (%<+ 0.3NTU)		NR		≤ 0.3
	Total Coliform Bacteria	#pos/mo	NR	1	
<b>Radiologicals</b>	Comb. Radium	ppm	1.6		5
	Gross ALPHA	(pCi/L)	2.97		15
	SOCs		NR		
	VOCs		NR		


**Notes:**


Results are from Northern Hills 2019 - 2023 Water Quality Reports. NR = No Record

<sup>a</sup> The Well Effluent column reflects the water in the distribution system. ND = Non Detect

<sup>b</sup> MCL = Maximum Contaminant Level MCLG=Maximum Contaminant Level Goal

 Highlighted value indicates finished water concentration exceeds Primary MCL for parameter. In all cases, treatment is in place to reduce concentration below the MCL, and routine monitoring is required.

 Highlighted value indicates finished water concentration exceeds Secondary MCL for parameter. In some cases, treatment is in place to reduce concentration below the MCL, and routine monitoring is recommended.

 Highlighted value indicates finished water concentration for parameter that may be approaching Primary or Secondary MCL or may cause water quality issues. In some cases, treatment is in place to reduce concentration below the MCL, and routine monitoring is recommended.



### 3.6 Identification of Potential Sources of Contamination to the Source Water

To identify all potential sources of contamination to the source water, both land use contamination and point source contamination were investigated. The proximity of the wells to shallow water bodies was also considered.


The point sources were identified using several hazardous chemical inventory databases. A list of a select number of databases used to determine potential sources of contamination to the System's wells are as follows:

- Agency Facility Inventory and Information Search System (AFIIS) (IEPA)
- Environmental Compliance and History Online (ECHO) (USEPA)
- Tier 2 Hazardous Chemical Database (IEMA Tier 2) (IEMA)
- Illinois Underground Storage Tank Database (IUST) (ISFM)
- Leaking Underground Storage Tank Database (LUST) (IEPA)
- Site Remediation Program Database (SRP) (IEPA)
- National Priority List (NPL)
- Comprehensive Environmental Response, Compensation and Liability Information System (CERCLIS)
- Resource Conservation and Recovery Act Generator List (RCRA LQG)
- Emergency Response Notification System (ERNS)
- Facility Response Plan (FRP)
- FEMA Underground Storage Tank Listing (FEMA UST)
- Clean Construction or Demolition Debris (CCDD)
- Above Ground Storage Tank (AST)

An environmental consultant, A3 Environmental, was engaged to assist in identifying potential sources of contamination within the maximum setback zone of each well. The consultant performed a search of publicly available information from environmental contamination databases belonging to federal, state, tribal, and local sources. These databases contain site specific history and details that aid in identifying if the contaminant is a threat to the source water.

In addition to these databases, the location of oil and gas pipelines and railroad lines were also evaluated. Sites within the well's 200- and 1,000-foot setback zones were considered as possible threats to groundwater quality. As shown in Exhibit 3-3, there were no point source contaminants identified for either well within the setback zones of the well.

**Exhibit 3-3: Map of Potential Sources of Contamination**

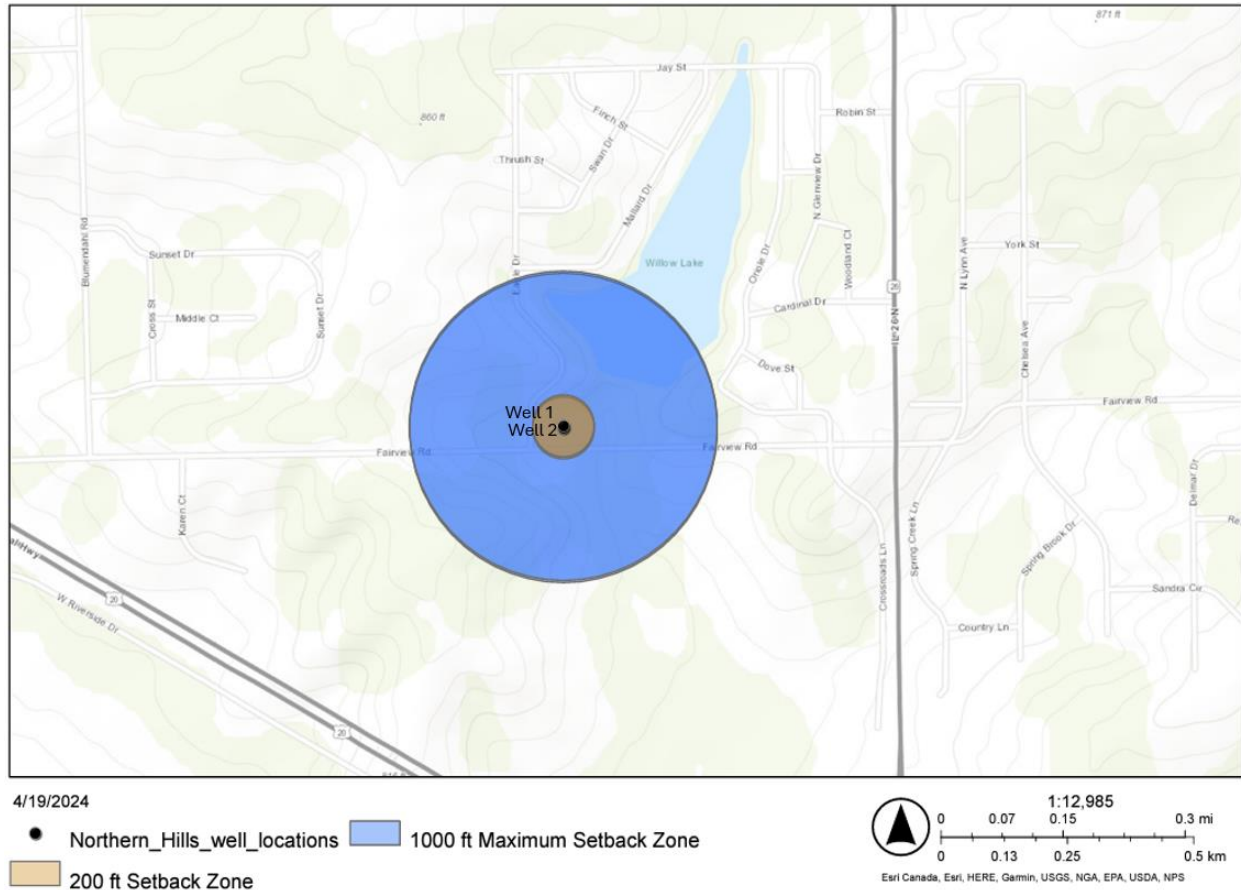


### 3.7 Analysis of the Source Water's Susceptibility to Contamination

The wells operated by the Northern Hills CWS are shallow bedrock wells drawing from sandstone, limestone, and dolomite aquifers. The Galena-Platteville and Silurian-Dolomite aquifers are integral to many northern Illinois community water supplies including Northern Hills. Shallow wells are typically more vulnerable to surface contamination than deep wells because of their lack of bedrock cover due to their proximity to the surface.

Exhibit 3-4 shows the map of geologic susceptibility along with Well 1 and Well 2. The well is located in an area with a geologic susceptibility rating of A1, characterized as impermeable bedrock at 20 feet or less from the surface with till or other fine-grained material overlay. The system's well is a shallow bedrock well, so it is somewhat susceptible to contamination due to its proximity to the surface but because the well is cased off through the uppermost sand and gravel layers, the susceptibility is decreased. Therefore, the geologic susceptibility to contamination of groundwater pumped by the well is considered moderately low.

**Exhibit 3-4: Groundwater Susceptibility**

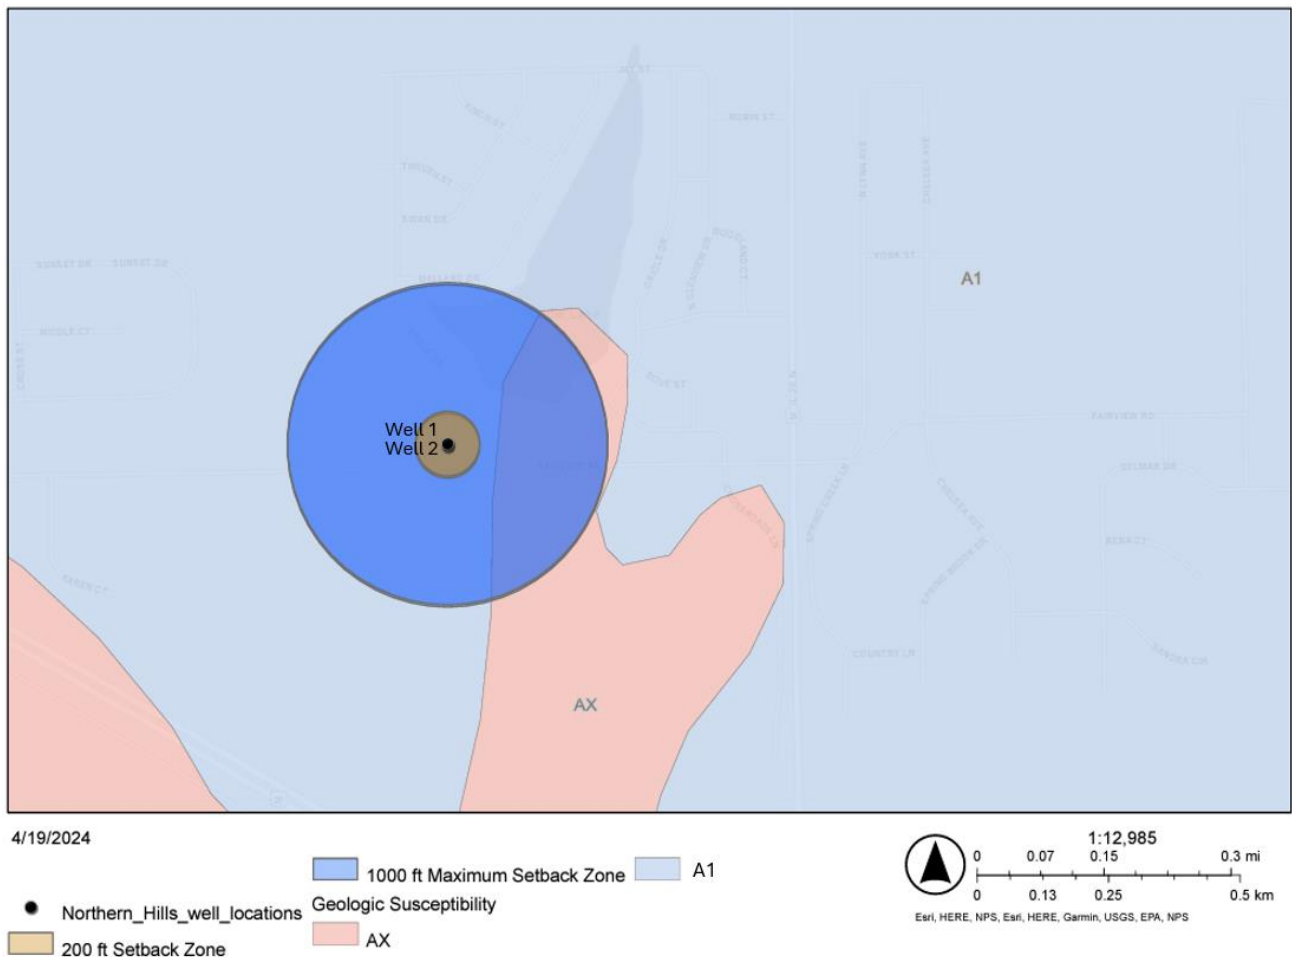

### **3.8 Explanation of the Community Water Supply's Efforts to Protect its Source Water**

- The Illinois Environmental Protection Act provides a minimum protection zone of 200 feet for Well 1 and Well 2. These minimum protection zones are regulated by the Illinois EPA.
- The System's SCADA system monitors each well 24/7.
- The Northern Hills CWS maintains the Emergency Response Plan as contingency planning documents to ensure that, through emergency preparedness, the community minimizes its risk of being without safe and adequate drinking water.
- The following regulations, which contribute to source water protection are currently active in the System:
  1. Minimum Setback Zones (200 and 400 feet, as designated by Illinois EPA) (415 ILCS 5/14.1 - 14.3)
  2. Well Construction and Pump Installation (77 ILL ADMIN CODE PART 915, 920 and 925)
  3. Backflow and Cross-Connection Programs Required (Illinois Plumbing Code, 77 Ill. Adm. Code 890)
  4. Stormwater Management Program (Administered by Stephenson County)

## SECTION 4: SOURCE WATER PROTECTION PLAN OBJECTIVES

This section presents the Northern Hills CWS's adherence to the requirements of Section 604.320 Source Water Protection Plan Objectives, which are:

*The source water protection plan must contain a list of the community water supply's objectives for protecting source water. These objectives can include meeting the requirements of any of the Sections in this Subpart, including developing a vision statement or performing a source water assessment. Objectives may also address the specific problems or issues identified in the source water assessment and should consider current and potential future issues.*

### 4.1 Identified Concerns

The following concerns regarding the Northern Hills CWS's source water were identified based on the source water assessment.

- Impacts of existing and potential future contamination on the Northern Hills CWS's source water.
- Impacts of source water contamination on the Northern Hills CWS's finished drinking water quality.
- Implications of removing existing and potential future contamination from the Northern Hills CWS's source water to meet drinking water standards.
- Identifying and implementing effective programs and activities for protecting the Northern Hills CWS's source water.

### 4.2 Objectives

Given the identified concerns, the Northern Hills CWS developed the following SWPP objectives. These objectives provide a framework for the Northern Hills CWS's source water protection activities. The specific activities that align with these objectives are outlined in Section 5 of this Plan.

#### I. Source Water Characterization / Protection Area Delineation

- A. Characterize the aquifers used by Northern Hills CWS as the source of water supply by identifying groundwater flow patterns, estimating hydraulic properties, and analyzing groundwater quality sampling results.

## II. Potential Contaminant Source and Land Use Inventories

- A. Use local, state, and federal data resources to identify the location and nature of potential sources of groundwater contamination and associated land uses within the source water protection areas of Northern Hills CWS water supply wells.

## III. Source Water Protection Management

- A. Public Engagement - Engage the community at-large and provide additional opportunities for source water protection stakeholders.
- B. Source Water Monitoring - Continue to monitor the quality of source water as needed to characterize constituents and ensure the safety of drinking water, always seeking to identify potential future threats to source water and finished water.
- C. Contingency Planning - Maintain and update existing emergency response plans, particularly as it pertains to groundwater contamination.
- D. Existing Regulatory - Leverage existing local, state, and federal regulations / programs that include source water protection components and incorporate into Northern Hills CWS's source water protection program.
- E. New Regulatory - Consider additional programs that will contribute to protecting source water and incorporate those that are applicable into Northern Hills CWS's source water protection program.
- F. Planning - Actively review, update, and improve all aspects of Northern Hills CWS's Source Water Protection Plan.

## SECTION 5: ACTION PLAN

This section presents the System's adherence to the requirements of Section 604.325 Action Plan, which are:

*In the action plan, the community water supply must identify the actions needed to achieve the community water supply's objectives determined under Section 604.320. The action plan must include the following:*

- a) descriptions of all projects, programs, and activities developed by the community water supply to meet the objectives listed in Section 604.320;*
- b) the community water supply's schedule for implementing projects, programs and activities;*
- c) an identification of the necessary resources to implement the plan; and*
- d) an identification of the potential problems with and obstacles to implementing the plan.*

### 5.1 Projects, Programs, and Activities to Meet Objectives

To meet its Source Water Protection Objectives, the System will continue its current initiatives (as described in Section 3.8), as well as implement the projects, programs, and activities identified below. The entire Action Plan including objectives; projects, programs, and activities; schedule; necessary resources; and potential problems is presented in Table No. 5-1.

### 5.2 Schedule for Implementing Projects, Programs, and Activities

The schedule for implementing the projects, programs, and activities of the System's Source Water Protection Program is presented in Table No. 5-1.

### 5.3 Identification of Necessary Resources to Implement the Plan

The resources necessary for implementation of the plan and the specific projects, programs, and activities requiring these resources are identified in the Action Plan presented in Table No. 5-1.

#### **5.4 Identification of Potential Problems and Obstacles in Implementing the Plan**

The potential problems and obstacles in implementing the plan and the specific projects, programs, and activities requiring these resources are identified in the Action Plan presented in Table No. 5-1.



**PRAIRIE PATH WATER COMPANY - NORTHERN HILLS CWS SOURCE WATER PROTECTION PLAN (July 2024)**

Category	Objective	Projects, Programs, and Activities	Schedule	Necessary Resources	Potential Problems
I. Source Water Characterization / Protection Area Delineation	A. Characterize the aquifers used by Northern Hills CWS as the source of water supply by identifying groundwater flow patterns, estimating hydraulic properties, and analyzing groundwater quality sampling results.	1. Review delineated maximum setback and recharge zones refine/update as necessary.	July 2029	Staff time	Limited data available
		2. Collect static and pumping water levels along with well pumping rates; Collect well performance data during well rehabilitation and testing. Analyze these data for anomalies and trends.	Annually	Staff time	Other priorities
		3. Designate source water protection areas for each of PPWC's water supply wells. For example: minimum setback zone (200 or 400 feet), maximum setback zone (1,000 feet), or recharge areas.	Completed	N/A	N/A
II. Potential Contaminant Source and Land Use Inventories	A. Use local, state, and federal data resources to identify the location and nature of potential sources of groundwater contamination and associated land uses within the source water protection areas of Northern Hills CWS water supply wells.	1. PPWC staff conduct visual surveys of activities within the minimum and maximum setback zones of water supply wells.	Monthly	Staff time	None
		2. Coordinate with jurisdictional authorities to monitor land use changes within the protection areas.	July 2029	Staff time	Cooperation of jurisdictions
		3. Establish program to engage local Fire Protection Authorities.	July 2029	Staff Time	Interest of jurisdictions
III. Source Water Protection Management	A. Public Engagement - Engage the community at-large and provide additional opportunities for source water protection stakeholders.	1. Public Awareness - Develop and distribute information regarding PPWC source water, including: • Newsletters • Annual Water Quality Report • Bill stuffers / Specialty mailers	Annually	Staff time	None -WQ Report must be updated for compliance
		2. Public Education - Educate community and property owners on how they can participate in PPWC's source water protection efforts.	July 2029	Staff time	Stakeholder interest
		3. Public Involvement - Consider creating local source water protection group to promote communication and collaboration on all matters pertaining to source water protection.	July 2029	Staff time	Stakeholder interest
	B. Source Water Monitoring - Continue to monitor the quality of source water as needed to characterize constituents and ensure the safety of drinking water, always seeking to identify potential future threats to source water and finished water.	1. Monitor known and emerging contaminants, including the collection of source water samples for current and emerging contaminants and the analysis of these data for anomalies and trends.	As required	Staff time	None - Must be completed for compliance
	C. Contingency Planning - Maintain and update existing emergency response plans, particularly as it pertains to groundwater contamination.	1. Update Emergency Response Plan (ERP)	Annually	Staff time	Competing priorities

**PRAIRIE PATH WATER COMPANY - NORTHERN HILLS CWS SOURCE WATER PROTECTION PLAN page 2 (July 2024)**

III. Source Water Protection Management (continued)	D. <b>Existing Regulatory</b> - Leverage existing local, state, and federal regulations / programs that include source water protection components and incorporate into Northern Hills CWS's source water protection program.	1. Minimum Setback Zones (200 and 400 feet, as designated by Illinois EPA) (415 ILCS 5/14.1 - 14.3)	Ongoing	Staff time	None - State regulation
		2. Well Construction and Pump Installation (77 ILL ADMIN CODE PART 915, 920 and 925)	Ongoing	Staff time	None - local regs.
		3. Backflow and Cross-Connection Programs Required (Illinois Plumbing Code, 77 Ill. Adm. Code 890)	Ongoing	Staff time	None - State regulation
		4. Stormwater Management Program (Administered by Jo Daviess County Planning & Development Department)	Ongoing	Staff time	None - local regs.
	E. <b>New Regulatory</b> - Consider additional programs that will contribute to protecting source water and incorporate those that are applicable into Northern Hills CWS's source water protection program.	1. Overlay Ordinance establishing a 1,000-foot maximum setback zone.	July 2029	Staff time	Cooperation of local jurisdiction
		2. Signage at wells and water treatment facilities	July 2029	Staff time, cost of signs	None
		3. Land acquisition / Conservation easements	July 2029	Staff time, funding	Availability of land
	F. <b>Planning</b> - Actively review, update, and improve all aspects of Northern Hills CWS's Source Water Protection Plan.	1. Participation in the Local Emergency Planning Committee (LEPC) or other local water resources planning agencies.	July 2029	Staff time	Competing priorities
		2. Support County Water Sustainability efforts (if applicable).	July 2029	Staff time	Existence of such programs
		3. Periodic review and updating of the Source Water Protection Plan Vision statement, Source Water Assessment, Objectives, and Action Plan with input from external stakeholders.	July 2029	Staff time / Consultant	None -required for compliance

# ***APPENDIX A***

## ***Illinois Administrative Code Title 35, Subpart 604, Subpart C - Source Water Protection Plan***

TITLE 35: ENVIRONMENTAL PROTECTION  
SUBTITLE F: PUBLIC WATER SUPPLIES  
CHAPTER I: POLLUTION CONTROL BOARD

PART 604  
DESIGN, OPERATION AND MAINTENANCE CRITERIA

SUBPART C: SOURCE WATER PROTECTION PLAN

**Section 604.300 Purpose**

The purpose of the following requirements is to facilitate protection of source water quality and quantity.

**Section 604.305 Source Water Protection Plan Requirement and Contents**

Each community water supply that treats surface or groundwater as a primary or emergency supply of water must develop a source water protection plan that contains the following minimum elements:

- a) a vision statement as set forth in Section 604.310;
- b) a source water assessment as set forth in Section 604.315;
- c) the objectives set forth in Section 604.320; and
- d) an action plan as set forth in Section 604.325.

**Section 604.310 Vision Statement**

The vision statement must include the following:

- a) the community water supply's policy and commitment to protecting source water;
- b) an explanation of the community water supply's resources to protect source water;
- c) an explanation of the barriers to protecting source water; and
- d) the names of the individuals who developed the vision statement.

**Section 604.315 Source Water Assessment**

- a) The source water assessment must contain the following information:
  - 1) statement of the importance of the source water;

- 2) a list of water supplies that obtain water from this community water supply;
  - 3) delineation of all sources of water used by the community water supply, including:
    - A) for surface water, description of the watershed, map of the watershed, and intake locations;
    - B) for groundwater, the well identification number, well description, well status and well depth; a description of setback zones, and a description of the aquifer for each well;
  - 4) a report on the quality of the source water for all sources of water delineated in subsection (a)(3), including:
    - A) when and where samples used to determine the quality of the source water were taken. These samples must be tested by a certified laboratory; and
    - B) the certified laboratory's results;
  - 5) a report on the quality of the finished water;
  - 6) identification of potential sources of contamination to the source water;
  - 7) analysis of the source water's susceptibility to contamination; and
  - 8) explanation of the community water supply's efforts to protect its source water.
- b) Upon request, the Agency will provide technical assistance to a community water supply in conducting the source water assessment.
- b) A community water supply may use a Source Water Assessment Program Fact Sheet prepared by the Agency to fulfill the requirements of this Section.

#### **Section 604.320 Source Water Protection Plan Objectives**

The source water protection plan must contain a list of the community water supply's objectives for protecting source water. These objectives can include meeting the requirements of any of the Sections in this Subpart, including developing a vision statement or performing a source water

assessment. Objectives may also address the specific problems or issues identified in the source water assessment and should consider current and potential future issues.

### **Section 604.325 Action Plan**

In the action plan, the community water supply must identify the actions needed to achieve the community water supply's objectives determined under Section 604.320. The action plan must include the following:

- a) descriptions of all projects, programs, and activities developed by the community water supply to meet the objectives listed in Section 604.320;
- c) the community water supply's schedule for implementing projects, programs and activities;
- c) an identification of the necessary resources to implement the plan; and
- d) an identification of the potential problems with and obstacles to implementing the plan.

### **Section 604.330 Submission**

- a) A community water supply that first commenced construction after July 26, 2019, must develop and submit a source water protection plan simultaneously with the construction permit application.
- b) A community water supply in existence as of July 26, 2019, must develop and submit to the Agency for approval a source water protection plan within the following time frame after July 26, 2019:
  - 1) within 3 years, for a community water supply serving a population greater than 50,000 persons;
  - 2) within 4 years, for a community water supply serving a population of greater than 3,000 but less than or equal to 49,999 persons; or
  - 3) within 5 years, for a community water supply serving a population of less than or equal to 2,999 persons.
- d) An existing community water supply that anticipates using a new source of water for its supply must develop and submit a revised source water protection plan simultaneously with the construction permit application.

**Section 604.335 Agency Approval**

The Agency, not later than 45 days after the receipt of the source water protection plan, will either approve or disapprove the plan. If the Agency takes no action within the 45 days, the community water supply may deem the plan approved. A community water supply may waive the requirement that the Agency take an action within the 45 days by so advising the Agency in writing.

**Section 604.340 Evaluation and Revision**

The community water supply must review, and revise as necessary, its source water protection plan no less frequently than every five years. If the community water supply revises its source water protection plan, it must submit the plan to the Agency for approval under Section 604.335.

# ***APPENDIX B***

## ***Well Information***



Water Well for Business	Top	Bottom
clay	0	6
clay/sand	6	32
clay/gravel	32	71
limestone	71	77
very soft limestone	77	92
limestone	92	96
dolomite	96	147
sandstone	147	330
<b>Total Depth</b>		<b>330</b>
Casing: 8" STEEL from -1' to 174'		
Grout: CEMENT from 6 to 174.		
Water from sandstone at 147' to 330'.		
Static level 28' below casing top which is 1' above GL		
Pumping level 45' when pumping at 0 gpm for 1 hour		
Permanent pump installed at 120'		
Owner Address: ,		
Address of well: 1438 W. Fairview Rd.		
Location source: Global Positioning System verified		

Permit Date:

Permit #: EPA

COMPANY Olson Well &amp; Pump Inc.

FARM Utilities, Inc.

DATE DRILLED June 28, 1996

NO.

ELEVATION 0

COUNTY NO. 22344

LOCATION SW SW SE


LATITUDE 42.330996

LONGITUDE -89.640694

COUNTY Stephenson

API 121772234400

13 - 27N - 7E



Water Well	Top	Bottom
black topsoil	0	1
yellow clay	1	7
sand & gravel	7	30
Platteville	30	58
Galena	58	145
sandstone	145	310
<b>Total Depth</b>		<b>310</b>
Casing: 8" BLACK P.E. 24.70 LB from 0' to 100'		
Size hole below casing: 8"		
Water from sandstone at 145' to 310'.		
Static level 32' below casing top which is 1' above GL		
Pumping level 60' when pumping at 100 gpm for 2 hours		
Permanent pump installed at 105'		
Driller's Log filed		
Sample set # 59396 (0' - 310') Received: October 7, 1974		
Owner Address: R.F.D. 5 Freeport, IL		
Add'l loc. info: Subdivision: Northern Hills		
second sub-division		
Location source: Global Positioning System verified		

Permit Date: June 21, 1974

Permit #: 30753

COMPANY Coad, Floyd M.

FARM Shuey, James

DATE DRILLED September 27, 1974

NO. 1

ELEVATION 0

COUNTY NO. 20906

LOCATION 125'S line, 546'W line of SE SW SE


LATITUDE 42.331062

LONGITUDE -89.640613

COUNTY Stephenson

API 121772090600

13 - 27N - 7E



# ***APPENDIX C***

## ***Representative Source Water Quality Analytical Lab Reports***

## Northern Hills Water System

Sampling Location	Date Sampled	All results reported as Nanograms per liter(ng/L)				Result Below Health Advisory Level?
		PFOS	PFOA	Combined PFOS + PFOA	EPA Health Advisory Level	
Entry Point Well 1	6/24/2020	ND	ND	ND	70	Y
Entry Point Well 2	6/24/2020	ND	ND	ND	70	Y

- **PFOS** – Perfluorooctane Sulfonate
- **PFOA** – Perfluorooctanoic Acid
- **Health Advisory Level (HAL)** – To provide Americans, including the most sensitive populations, with a margin of protection from a lifetime of exposure to PFOA and PFOS from drinking water, EPA established the health advisory levels at 70 parts per trillion.
- **Ng/L** – Nanograms per liter(ng/L) which equals Parts per trillion (ppt) – One part per trillion corresponds to one minute in 2,000,000 years, or a single penny in \$10,000,000,000.
- **ND (No Detect)** - Laboratory analysis indicates that the constituent is not present. 2.0 ng/L is the minimum level the lab is reporting a detection for these parameters. The ND (No Detect) represented in the table is indicating there was no detection.

# Drinking Water Branch

## Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	GB02680-01	<b>Collection Date :</b>	02-13-2023

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2025
1010	BARIUM	200.8			0	32 UG/L	01-01-2023	12-31-2025
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2025
1017	CHLORIDE	300.0			0	2.2 MG/L	01-01-2023	12-31-2025
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2023	12-31-2025
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2020	12-31-2028
1025	FLUORIDE	4500F-C			0	0.671 MG/L	01-01-2023	12-31-2025
1028	IRON	200.7			0	0.48 MG/L	01-01-2023	12-31-2025
1031	MAGNESIUM	200.7			0	35 MG/L		
1032	MANGANESE	200.8			0	2.8 UG/L	01-01-2023	12-31-2025
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2023	12-31-2025
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2023	12-31-2025
1045	SELENIUM	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2025
1052	SODIUM	200.7			0	5.7 MG/L	01-01-2023	12-31-2025
1055	SULFATE	300.0			0	9.4 MG/L	01-01-2023	12-31-2025
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2023	12-31-2025
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2025
1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2023	12-31-2025
1095	ZINC	200.8			0	12 UG/L	01-01-2023	12-31-2025
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	300 MG/L	01-01-2023	12-31-2025
1919	CALCIUM	200.7			0	61 MG/L	01-01-2023	12-31-2025
1927	ALKALINITY, TOTAL	2320B			0	250 MG/L	01-01-2023	12-31-2025
1930	TDS	2540C			0	300 MG/L	01-01-2023	12-31-2025

**Total Number of Records Fetched = 23**

# Drinking Water Branch

## Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	0012500-01	<b>Collection Date :</b>	01-14-2020

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
1010	BARIUM	200.8			0	29 UG/L	01-01-2020	12-31-2022
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
1017	CHLORIDE	300.0			0	3.3 MG/L	01-01-2020	12-31-2022
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2020	12-31-2022
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2020	12-31-2028
1025	FLUORIDE	4500F-C			0	0.701 MG/L	01-01-2020	12-31-2022
1028	IRON	200.7			0	0.46 MG/L	01-01-2020	12-31-2022
1031	MAGNESIUM	200.7			0	34 MG/L		
1032	MANGANESE	200.8			0	2.4 UG/L	01-01-2020	12-31-2022
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2020	12-31-2022
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2020	12-31-2022
1045	SELENIUM	200.8	Y	MRL	2 UG/L		01-01-2020	12-31-2022
1052	SODIUM	200.7			0	5.2 MG/L	01-01-2020	12-31-2022
1055	SULFATE	300.0			0	11 MG/L	01-01-2020	12-31-2022
1074	ANTIMONY, TOTAL	200.8	Y	MRL	0.6 UG/L		01-01-2020	12-31-2022
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
1095	ZINC	200.8			0	19 UG/L	01-01-2020	12-31-2022
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	280 MG/L	01-01-2020	12-31-2022
1919	CALCIUM	200.7			0	59 MG/L	01-01-2020	12-31-2022
1927	ALKALINITY, TOTAL	2320B			0	300 MG/L	01-01-2020	12-31-2022
1930	TDS	2540C			0	330 MG/L	01-01-2020	12-31-2022
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2020	12-31-2028
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2020	12-31-2028
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2020	12-31-2028
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2020	12-31-2028
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2020	12-31-2028
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2020	12-31-2028
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2020	12-31-2028
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2028
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2020	12-31-2028
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		01-01-2020	12-31-2028
2051	LISSO	525.2	Y	MRL	0.2 UG/L		01-01-2020	12-31-2028
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2020	12-31-2028

2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2020	12-31-2028
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2020	12-31-2028
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2020	12-31-2028
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2020	12-31-2028
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2020	12-31-2028
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2020	12-31-2028
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2020	12-31-2028
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025

**Total Number of Records Fetched = 81**

# Drinking Water Branch

## Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	19F0606-01	<b>Collection Date :</b>	06-18-2019

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1002	ALUMINUM	200.8	Y	MRL	100 UG/L			
1003	NITROGEN-AMMONIA AS (N)	350.1			0	0.11 MG/L		
1005	ARSENIC	200.8	Y	MRL	1 UG/L			
1010	BARIUM	200.8			0	39.4 UG/L		
1015	CADMIUM	200.8	Y	MRL	3 UG/L			
1017	CHLORIDE	300.0	Y	MRL	1 MG/L			
1020	CHROMIUM	200.8	Y	MRL	5 UG/L			
1022	COPPER, FREE	200.8	Y	MRL	100 UG/L			
1024	CYANIDE	335.4	Y	MRL	0.005 MG/L			
1025	FLUORIDE	300.0			0	0.35 MG/L		
1028	IRON	200.7			0	455 UG/L		
1030	LEAD	200.8	Y	MRL	5 UG/L			
1031	MAGNESIUM	200.7			0	30400 UG/L		
1032	MANGANESE	200.8	Y	MRL	15 UG/L			
1035	MERCURY	245.1	Y	MRL	0.06 UG/L			
1036	NICKEL	200.8	Y	MRL	25 UG/L			
1038	NITRATE-NITRITE	353.2	Y	MRL	0.1 MG/L			
1042	POTASSIUM	200.7			0	1930 UG/L		
1045	SELENIUM	200.8	Y	MRL	2 UG/L			
1049	SILICA	200.7			0	10400 UG/L		
1050	SILVER	200.8	Y	MRL	10 UG/L			
1051	STRONTIUM	200.7			0	55.5 UG/L		
1052	SODIUM	200.7			0	2330 UG/L		
1055	SULFATE	300.0			0	10.5 MG/L		
1064	CONDUCTIVITY @ 25 C UMHS/CM	9911			0	493 SU		
1074	ANTIMONY, TOTAL	200.8	Y	MRL	2 UG/L			
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L			
1079	BORON, TOTAL	200.7			0	17.8 UG/L		
1081	COBALT, TOTAL	200.8	Y	MRL	10 UG/L			
1084	MOLYBDENUM, TOTAL	200.8	Y	MRL	20 UG/L			
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L			
1088	VANADIUM, TOTAL	200.8	Y	MRL	5 UG/L			
1093	PHOSPHORUS, TOTAL	365.1	Y	MRL	0.005 MG/L			
1095	ZINC	200.8	Y	MRL	100 UG/L			
1915	HARDNESS, TOTAL (AS CaCO3)	200.7			0	275000 UG/L		
1919	CALCIUM	200.7			0	58600 UG/L		
1926	PH FIELD	9911			0	6.49 SU		



1927	ALKALINITY, TOTAL	310.2			0	283 MG/L		
1930	TDS	2540C			0	322 MG/L		
1996	TEMPERATURE (CENTIGRADE)	9911			0	11.99 SU		
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2378	1,2,4- TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2380	CIS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2910	PHENOLS	420.4	Y	MRL	10 UG/L			
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L			
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L			
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L			
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2979	TRANS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L			
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L			
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2990	BENZENE	524.2	Y	MRL	0.5 UG/L			
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L			
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L			
2996	STYRENE	524.2	Y	MRL	0.5 UG/L			
6002	RUN TIME PRIOR TO SAMPLING (MIN)	9911			0	40 SU		
9997	FLOW (PUMPING) RATE (GAL/M)	9911			0	125 SU		
9998	OXIDATION-REDUCTION POTENTIAL (EH)	9911			0	131 SU		

**Total Number of Records Fetched = 66**

# Drinking Water Branch

## Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	19F0606-02	<b>Collection Date :</b>	06-18-2019

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1002	ALUMINUM	200.8	Y	MRL	100 UG/L			
1003	NITROGEN-AMMONIA AS (N)	350.1	Y	MRL	0.1 MG/L			
1005	ARSENIC	200.8	Y	MRL	1 UG/L			
1010	BARIUM	200.8			0	29.6 UG/L		
1015	CADMIUM	200.8	Y	MRL	3 UG/L			
1017	CHLORIDE	300.0	Y	MRL	1 MG/L			
1020	CHROMIUM	200.8	Y	MRL	5 UG/L			
1022	COPPER, FREE	200.8	Y	MRL	100 UG/L			
1024	CYANIDE	335.4	Y	MRL	0.005 MG/L			
1025	FLUORIDE	300.0	Y	MRL	0.1 MG/L			
1028	IRON	200.7			0	469 UG/L		
1030	LEAD	200.8	Y	MRL	5 UG/L			
1031	MAGNESIUM	200.7			0	32500 UG/L		
1032	MANGANESE	200.8	Y	MRL	15 UG/L			
1035	MERCURY	245.1	Y	MRL	0.06 UG/L			
1036	NICKEL	200.8	Y	MRL	25 UG/L			
1038	NITRATE-NITRITE	353.2	Y	MRL	0.1 MG/L			
1042	POTASSIUM	200.7			0	2020 UG/L		
1045	SELENIUM	200.8	Y	MRL	2 UG/L			
1049	SILICA	200.7			0	10000 UG/L		
1050	SILVER	200.8	Y	MRL	10 UG/L			
1051	STRONTIUM	200.7			0	51.3 UG/L		
1052	SODIUM	200.7			0	2120 UG/L		
1055	SULFATE	300.0	Y	MRL	10 MG/L			
1064	CONDUCTIVITY @ 25 C UMHS/CM	9911			0	491 SU		
1074	ANTIMONY, TOTAL	200.8	Y	MRL	2 UG/L			
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L			
1079	BORON, TOTAL	200.7			0	21.6 UG/L		
1081	COBALT, TOTAL	200.8	Y	MRL	10 UG/L			
1084	MOLYBDENUM, TOTAL	200.8	Y	MRL	20 UG/L			
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L			
1088	VANADIUM, TOTAL	200.8	Y	MRL	5 UG/L			
1093	PHOSPHORUS, TOTAL	365.1	Y	MRL	0.005 MG/L			
1095	ZINC	200.8	Y	MRL	100 UG/L			
1915	HARDNESS, TOTAL (AS CaCO3)	200.7			0	275000 UG/L		
1919	CALCIUM	200.7			0	55400 UG/L		
1926	PH FIELD	9911			0	6.53 SU		

1927	ALKALINITY, TOTAL	310.2			0	286 MG/L		
1930	TDS	2540C			0	328 MG/L		
1996	TEMPERATURE (CENTIGRADE)	9911			0	11.9 SU		
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2378	1,2,4- TRICHLOROENZENE	524.2	Y	MRL	0.5 UG/L			
2380	CIS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2910	PHENOLS	420.4	Y	MRL	10 UG/L			
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L			
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L			
2968	O-DICHLOROENZENE	524.2	Y	MRL	0.5 UG/L			
2969	P-DICHLOROENZENE	524.2	Y	MRL	0.5 UG/L			
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L			
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2979	TRANS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L			
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L			
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2989	CHLOROENZENE	524.2	Y	MRL	0.5 UG/L			
2990	BENZENE	524.2	Y	MRL	0.5 UG/L			
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L			
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L			
2996	STYRENE	524.2	Y	MRL	0.5 UG/L			
6002	RUN TIME PRIOR TO SAMPLING (MIN)	9911			0	40 SU		
9997	FLOW (PUMPING) RATE (GAL/M)	9911			0	110 SU		
9998	OXIDATION-REDUCTION POTENTIAL (EH)	9911			0	125 SU		

**Total Number of Records Fetched = 66**

# Drinking Water Branch

## Chem/Rad Sample Results

[Return  
Links](#)

[Chem/Rad  
Samples](#)

[Analyte List](#)

[Water System  
Detail](#)

[Water  
Systems](#)

[Water System  
Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	7012874-01	<b>Collection Date :</b>	01-17-2017

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2019
1010	BARIUM	200.8			0	36 UG/L	01-01-2017	12-31-2019
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2019
1017	CHLORIDE	300.0			0	1.3 MG/L	01-01-2017	12-31-2019
1020	CHROMIUM	200.8	Y	MRL	5 UG/L		01-01-2017	12-31-2019
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2011	12-31-2019
1025	FLUORIDE	4500F-C	Y	MRL	0.25 MG/L		01-01-2017	12-31-2019
1028	IRON	200.7			0	0.44 MG/L	01-01-2017	12-31-2019
1031	MAGNESIUM	200.7			0	31 MG/L		
1032	MANGANESE	200.8			0	3.3 UG/L	01-01-2017	12-31-2019
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2017	12-31-2019
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2017	12-31-2019
1045	SELENIUM	200.8	Y	MRL	2 UG/L		01-01-2017	12-31-2019
1052	SODIUM	200.7			0	2.2 MG/L	01-01-2017	12-31-2019
1055	SULFATE	300.0			0	11 MG/L	01-01-2017	12-31-2019
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2017	12-31-2019
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2017	12-31-2019
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2017	12-31-2019
1095	ZINC	200.8			0	22 UG/L	01-01-2017	12-31-2019
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	260 MG/L	01-01-2017	12-31-2019
1919	CALCIUM	200.7	N		0	54 MG/L	01-01-2017	12-31-2019
1927	ALKALINITY, TOTAL	2320B			0	280 MG/L	01-01-2017	12-31-2019
1930	TDS	2540C			0	260 MG/L	01-01-2017	12-31-2019

**Total Number of Records Fetched = 23**

# Drinking Water Branch

## Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	4100802-01	<b>Collection Date :</b>	10-02-2014

This list displays sample/results of all non-microbial analytes (TSAONLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
1010	BARIUM	200.8			0	34 UG/L	01-01-2014	12-31-2016
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2014	12-31-2016
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2014	12-31-2016
1025	FLUORIDE	4500F-C	Y	MRL	0.25 MG/L		01-01-2014	12-31-2016
1028	IRON	200.7			0	0.42 MG/L	01-01-2014	12-31-2016
1032	MANGANESE	200.8			0	2.9 UG/L	01-01-2014	12-31-2016
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2014	12-31-2016
1036	NICKEL	200.8			0	7.7 UG/L	01-01-2014	12-31-2016
1045	SELENIUM	200.8	Y	MRL	5 UG/L		01-01-2014	12-31-2016
1052	SODIUM	200.7			0	2.2 MG/L	01-01-2014	12-31-2016
1055	SULFATE	300.0			0	11 MG/L	01-01-2014	12-31-2016
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2014	12-31-2016
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2014	12-31-2016
1095	ZINC	200.8			0	87 UG/L	01-01-2014	12-31-2016
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2014	12-31-2016
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2014	12-31-2016
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2014	12-31-2016
2034	GLYPHOSATE	547	Y	MRL	30 UG/L		01-01-2014	12-31-2016
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2014	12-31-2016
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2043	ALDICARB SULFOXIDE	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2044	ALDICARB SULFONE	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2014	12-31-2016
2047	ALDICARB	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2014	12-31-2016
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016

2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2014	12-31-2016
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2014	12-31-2016
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L			
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016

**Total Number of Records Fetched = 59**

# Drinking Water Branch

## Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	4012973-01	<b>Collection Date :</b>	01-16-2014

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
1010	BARIUM	200.8			0	31 UG/L	01-01-2014	12-31-2016
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2014	12-31-2016
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2011	12-31-2019
1025	FLUORIDE	4500F-C			0	0.499 MG/L	01-01-2014	12-31-2016
1028	IRON	200.7			0	0.55 MG/L	01-01-2014	12-31-2016
1032	MANGANESE	200.8			0	2.5 UG/L	01-01-2014	12-31-2016
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2014	12-31-2016
1036	NICKEL	200.8			0	5.1 UG/L	01-01-2014	12-31-2016
1045	SELENIUM	200.8	Y	MRL	5 UG/L		01-01-2014	12-31-2016
1052	SODIUM	200.7			0	7.2 MG/L	01-01-2014	12-31-2016
1055	SULFATE	300.0			0	12 MG/L	01-01-2014	12-31-2016
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2014	12-31-2016
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2014	12-31-2016
1095	ZINC	200.8			0	64 UG/L	01-01-2014	12-31-2016
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019

2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019

**Total Number of Records Fetched = 39**



# Drinking Water Branch

## Chem/Rad Sample Results

### Return Links

[Chem/Rad  
Samples](#)

[Analyte List](#)

[Water System  
Detail](#)

[Water Systems](#)

[Water System  
Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	3073776-01	<b>Collection Date :</b>	07-17-2013

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2011	12-31-2013

**Total Number of Records Fetched = 1**

# Drinking Water Branch

## Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	0012500-01	<b>Collection Date :</b>	01-14-2020

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
1010	BARIUM	200.8			0	29 UG/L	01-01-2020	12-31-2022
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
1017	CHLORIDE	300.0			0	3.3 MG/L	01-01-2020	12-31-2022
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2020	12-31-2022
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2020	12-31-2028
1025	FLUORIDE	4500F-C			0	0.701 MG/L	01-01-2020	12-31-2022
1028	IRON	200.7			0	0.46 MG/L	01-01-2020	12-31-2022
1031	MAGNESIUM	200.7			0	34 MG/L		
1032	MANGANESE	200.8			0	2.4 UG/L	01-01-2020	12-31-2022
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2020	12-31-2022
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2020	12-31-2022
1045	SELENIUM	200.8	Y	MRL	2 UG/L		01-01-2020	12-31-2022
1052	SODIUM	200.7			0	5.2 MG/L	01-01-2020	12-31-2022
1055	SULFATE	300.0			0	11 MG/L	01-01-2020	12-31-2022
1074	ANTIMONY, TOTAL	200.8	Y	MRL	0.6 UG/L		01-01-2020	12-31-2022
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
1095	ZINC	200.8			0	19 UG/L	01-01-2020	12-31-2022
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	280 MG/L	01-01-2020	12-31-2022
1919	CALCIUM	200.7			0	59 MG/L	01-01-2020	12-31-2022
1927	ALKALINITY, TOTAL	2320B			0	300 MG/L	01-01-2020	12-31-2022
1930	TDS	2540C			0	330 MG/L	01-01-2020	12-31-2022
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2020	12-31-2028
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2020	12-31-2028
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2020	12-31-2028
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2020	12-31-2028
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2020	12-31-2028
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2020	12-31-2028
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2020	12-31-2028
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2028
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2020	12-31-2028
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		01-01-2020	12-31-2028
2051	LISSO	525.2	Y	MRL	0.2 UG/L		01-01-2020	12-31-2028
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2020	12-31-2028

2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2020	12-31-2028
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2020	12-31-2028
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2020	12-31-2028
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2020	12-31-2028
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2020	12-31-2028
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2020	12-31-2028
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2020	12-31-2028
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025

**Total Number of Records Fetched = 81**

# Drinking Water Branch

## Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	4100802-01	<b>Collection Date :</b>	10-02-2014

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2016
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2016
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2016
2020	TOXAPHENE	505	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2014	12-31-2016
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2014	12-31-2016
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2014	12-31-2016
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		01-01-2014	12-31-2016
2051	LASSO	525.2	Y	MRL	0.2 UG/L		01-01-2014	12-31-2016
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2014	12-31-2016
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2014	12-31-2016
2070	DIELDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2014	12-31-2016
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2016
2306	BENZO(A)PYRENE	525.2	Y	MRL	0.1 UG/L		01-01-2014	12-31-2016
2356	ALDRIN	525.2	Y	MRL	0.05 UG/L		01-01-2014	12-31-2016
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	505	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2959	CHLORDANE	505	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016

**Total Number of Records Fetched = 20**

# Drinking Water Branch

## Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	0012500-01	<b>Collection Date :</b>	01-14-2020

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
1010	BARIUM	200.8			0	29 UG/L	01-01-2020	12-31-2022
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
1017	CHLORIDE	300.0			0	3.3 MG/L	01-01-2020	12-31-2022
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2020	12-31-2022
1024	CYANIDE	335.4	Y	MRL	0.2 MG/L		01-01-2020	12-31-2028
1025	FLUORIDE	4500F-C			0	0.701 MG/L	01-01-2020	12-31-2022
1028	IRON	200.7			0	0.46 MG/L	01-01-2020	12-31-2022
1031	MAGNESIUM	200.7			0	34 MG/L		
1032	MANGANESE	200.8			0	2.4 UG/L	01-01-2020	12-31-2022
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2020	12-31-2022
1036	NICKEL	200.8	Y	MRL	5 UG/L		01-01-2020	12-31-2022
1045	SELENIUM	200.8	Y	MRL	2 UG/L		01-01-2020	12-31-2022
1052	SODIUM	200.7			0	5.2 MG/L	01-01-2020	12-31-2022
1055	SULFATE	300.0			0	11 MG/L	01-01-2020	12-31-2022
1074	ANTIMONY, TOTAL	200.8	Y	MRL	0.6 UG/L		01-01-2020	12-31-2022
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
1085	THALLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2020	12-31-2022
1095	ZINC	200.8			0	19 UG/L	01-01-2020	12-31-2022
1915	HARDNESS, TOTAL (AS CaCO3)	2340B			0	280 MG/L	01-01-2020	12-31-2022
1919	CALCIUM	200.7			0	59 MG/L	01-01-2020	12-31-2022
1927	ALKALINITY, TOTAL	2320B			0	300 MG/L	01-01-2020	12-31-2022
1930	TDS	2540C			0	330 MG/L	01-01-2020	12-31-2022
2005	ENDRIN	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2010	BHC-GAMMA	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2015	METHOXYCHLOR	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2020	TOXAPHENE	525.2	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2020	12-31-2028
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2020	12-31-2028
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2020	12-31-2028
2035	DI(2-ETHYLHEXYL) ADIPATE	525.2	Y	MRL	0.6 UG/L		01-01-2020	12-31-2028
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2020	12-31-2028
2037	SIMAZINE	525.2	Y	MRL	0.35 UG/L		01-01-2020	12-31-2028
2039	DI(2-ETHYLHEXYL) PHTHALATE	525.2	Y	MRL	1.8 UG/L		01-01-2020	12-31-2028
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2042	HEXACHLOROCYCLOPENTADIENE	525.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2028
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2020	12-31-2028
2050	ATRAZINE	525.2	Y	MRL	0.3 UG/L		01-01-2020	12-31-2028
2051	LISSO	525.2	Y	MRL	0.2 UG/L		01-01-2020	12-31-2028
2065	HEPTACHLOR	525.2	Y	MRL	0.04 UG/L		01-01-2020	12-31-2028

2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2067	HEPTACHLOR EPOXIDE	525.2	Y	MRL	0.02 UG/L		01-01-2020	12-31-2028
2070	DIELDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2020	12-31-2028
2077	PROPACHLOR	525.2	Y	MRL	0.5 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2274	HEXACHLOROBENZENE	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2306	BENZO(A)PYRENE	550	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2020	12-31-2028
2356	ALDRIN	525.2	Y	MRL	0.25 UG/L		01-01-2020	12-31-2028
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	525.2	Y	MRL	0.1 UG/L		01-01-2020	12-31-2028
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2775	TOTAL DDT	525.2	Y	MRL	1 UG/L		01-01-2020	12-31-2028
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2020	12-31-2028
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2020	12-31-2028
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2959	CHLORDANE	525.2	Y	MRL	0.2 UG/L		01-01-2020	12-31-2028
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2020	12-31-2025

**Total Number of Records Fetched = 81**

# Drinking Water Branch

## Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	19F0606-01	<b>Collection Date :</b>	06-18-2019

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1002	ALUMINUM	200.8	Y	MRL	100 UG/L			
1003	NITROGEN-AMMONIA AS (N)	350.1			0	0.11 MG/L		
1005	ARSENIC	200.8	Y	MRL	1 UG/L			
1010	BARIUM	200.8			0	39.4 UG/L		
1015	CADMIUM	200.8	Y	MRL	3 UG/L			
1017	CHLORIDE	300.0	Y	MRL	1 MG/L			
1020	CHROMIUM	200.8	Y	MRL	5 UG/L			
1022	COPPER, FREE	200.8	Y	MRL	100 UG/L			
1024	CYANIDE	335.4	Y	MRL	0.005 MG/L			
1025	FLUORIDE	300.0			0	0.35 MG/L		
1028	IRON	200.7			0	455 UG/L		
1030	LEAD	200.8	Y	MRL	5 UG/L			
1031	MAGNESIUM	200.7			0	30400 UG/L		
1032	MANGANESE	200.8	Y	MRL	15 UG/L			
1035	MERCURY	245.1	Y	MRL	0.06 UG/L			
1036	NICKEL	200.8	Y	MRL	25 UG/L			
1038	NITRATE-NITRITE	353.2	Y	MRL	0.1 MG/L			
1042	POTASSIUM	200.7			0	1930 UG/L		
1045	SELENIUM	200.8	Y	MRL	2 UG/L			
1049	SILICA	200.7			0	10400 UG/L		
1050	SILVER	200.8	Y	MRL	10 UG/L			
1051	STRONTIUM	200.7			0	55.5 UG/L		
1052	SODIUM	200.7			0	2330 UG/L		
1055	SULFATE	300.0			0	10.5 MG/L		
1064	CONDUCTIVITY @ 25 C UMHS/CM	9911			0	493 SU		
1074	ANTIMONY, TOTAL	200.8	Y	MRL	2 UG/L			
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L			
1079	BORON, TOTAL	200.7			0	17.8 UG/L		
1081	COBALT, TOTAL	200.8	Y	MRL	10 UG/L			
1084	MOLYBDENUM, TOTAL	200.8	Y	MRL	20 UG/L			
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L			
1088	VANADIUM, TOTAL	200.8	Y	MRL	5 UG/L			
1093	PHOSPHORUS, TOTAL	365.1	Y	MRL	0.005 MG/L			
1095	ZINC	200.8	Y	MRL	100 UG/L			
1915	HARDNESS, TOTAL (AS CaCO3)	200.7			0	275000 UG/L		
1919	CALCIUM	200.7			0	58600 UG/L		
1926	PH FIELD	9911			0	6.49 SU		

1927	ALKALINITY, TOTAL	310.2			0	283 MG/L		
1930	TDS	2540C			0	322 MG/L		
1996	TEMPERATURE (CENTIGRADE)	9911			0	11.99 SU		
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2378	1,2,4- TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2380	CIS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2910	PHENOLS	420.4	Y	MRL	10 UG/L			
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L			
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L			
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L			
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2979	TRANS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L			
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L			
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2990	BENZENE	524.2	Y	MRL	0.5 UG/L			
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L			
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L			
2996	STYRENE	524.2	Y	MRL	0.5 UG/L			
6002	RUN TIME PRIOR TO SAMPLING (MIN)	9911			0	40 SU		
9997	FLOW (PUMPING) RATE (GAL/M)	9911			0	125 SU		
9998	OXIDATION-REDUCTION POTENTIAL (EH)	9911			0	131 SU		

**Total Number of Records Fetched = 66**



# Drinking Water Branch

## Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	19F0606-02	<b>Collection Date :</b>	06-18-2019

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1002	ALUMINUM	200.8	Y	MRL	100 UG/L			
1003	NITROGEN-AMMONIA AS (N)	350.1	Y	MRL	0.1 MG/L			
1005	ARSENIC	200.8	Y	MRL	1 UG/L			
1010	BARIUM	200.8			0	29.6 UG/L		
1015	CADMIUM	200.8	Y	MRL	3 UG/L			
1017	CHLORIDE	300.0	Y	MRL	1 MG/L			
1020	CHROMIUM	200.8	Y	MRL	5 UG/L			
1022	COPPER, FREE	200.8	Y	MRL	100 UG/L			
1024	CYANIDE	335.4	Y	MRL	0.005 MG/L			
1025	FLUORIDE	300.0	Y	MRL	0.1 MG/L			
1028	IRON	200.7			0	469 UG/L		
1030	LEAD	200.8	Y	MRL	5 UG/L			
1031	MAGNESIUM	200.7			0	32500 UG/L		
1032	MANGANESE	200.8	Y	MRL	15 UG/L			
1035	MERCURY	245.1	Y	MRL	0.06 UG/L			
1036	NICKEL	200.8	Y	MRL	25 UG/L			
1038	NITRATE-NITRITE	353.2	Y	MRL	0.1 MG/L			
1042	POTASSIUM	200.7			0	2020 UG/L		
1045	SELENIUM	200.8	Y	MRL	2 UG/L			
1049	SILICA	200.7			0	10000 UG/L		
1050	SILVER	200.8	Y	MRL	10 UG/L			
1051	STRONTIUM	200.7			0	51.3 UG/L		
1052	SODIUM	200.7			0	2120 UG/L		
1055	SULFATE	300.0	Y	MRL	10 MG/L			
1064	CONDUCTIVITY @ 25 C UMHS/CM	9911			0	491 SU		
1074	ANTIMONY, TOTAL	200.8	Y	MRL	2 UG/L			
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L			
1079	BORON, TOTAL	200.7			0	21.6 UG/L		
1081	COBALT, TOTAL	200.8	Y	MRL	10 UG/L			
1084	MOLYBDENUM, TOTAL	200.8	Y	MRL	20 UG/L			
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L			
1088	VANADIUM, TOTAL	200.8	Y	MRL	5 UG/L			
1093	PHOSPHORUS, TOTAL	365.1	Y	MRL	0.005 MG/L			
1095	ZINC	200.8	Y	MRL	100 UG/L			
1915	HARDNESS, TOTAL (AS CaCO3)	200.7			0	275000 UG/L		
1919	CALCIUM	200.7			0	55400 UG/L		
1926	PH FIELD	9911			0	6.53 SU		

1927	ALKALINITY, TOTAL	310.2			0	286 MG/L		
1930	TDS	2540C			0	328 MG/L		
1996	TEMPERATURE (CENTIGRADE)	9911			0	11.9 SU		
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2378	1,2,4- TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2380	CIS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2910	PHENOLS	420.4	Y	MRL	10 UG/L			
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L			
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L			
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L			
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2979	TRANS-1,2- DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L			
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L			
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L			
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L			
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L			
2990	BENZENE	524.2	Y	MRL	0.5 UG/L			
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L			
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L			
2996	STYRENE	524.2	Y	MRL	0.5 UG/L			
6002	RUN TIME PRIOR TO SAMPLING (MIN)	9911			0	40 SU		
9997	FLOW (PUMPING) RATE (GAL/M)	9911			0	110 SU		
9998	OXIDATION-REDUCTION POTENTIAL (EH)	9911			0	125 SU		

**Total Number of Records Fetched = 66**

# Drinking Water Branch

## Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	4100802-01	<b>Collection Date :</b>	10-02-2014

This list displays sample/results of all non-microbial analytes (TSAONLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
1010	BARIUM	200.8			0	34 UG/L	01-01-2014	12-31-2016
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2014	12-31-2016
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2014	12-31-2016
1025	FLUORIDE	4500F-C	Y	MRL	0.25 MG/L		01-01-2014	12-31-2016
1028	IRON	200.7			0	0.42 MG/L	01-01-2014	12-31-2016
1032	MANGANESE	200.8			0	2.9 UG/L	01-01-2014	12-31-2016
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2014	12-31-2016
1036	NICKEL	200.8			0	7.7 UG/L	01-01-2014	12-31-2016
1045	SELENIUM	200.8	Y	MRL	5 UG/L		01-01-2014	12-31-2016
1052	SODIUM	200.7			0	2.2 MG/L	01-01-2014	12-31-2016
1055	SULFATE	300.0			0	11 MG/L	01-01-2014	12-31-2016
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2014	12-31-2016
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2014	12-31-2016
1095	ZINC	200.8			0	87 UG/L	01-01-2014	12-31-2016
2021	CARBARYL	531.1	Y	MRL	2 UG/L			
2022	METHOMYL	531.1	Y	MRL	0.5 UG/L			
2031	DALAPON	515.3	Y	MRL	5 UG/L		01-01-2014	12-31-2016
2032	DIQUAT	549.2	Y	MRL	2 UG/L		01-01-2014	12-31-2016
2033	ENDOTHALL	548.1	Y	MRL	9 UG/L		01-01-2014	12-31-2016
2034	GLYPHOSATE	547	Y	MRL	30 UG/L		01-01-2014	12-31-2016
2036	OXAMYL	531.1	Y	MRL	2 UG/L		01-01-2014	12-31-2016
2040	PICLORAM	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2041	DINOSEB	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2043	ALDICARB SULFOXIDE	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2044	ALDICARB SULFONE	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2046	CARBOFURAN	531.1	Y	MRL	0.9 UG/L		01-01-2014	12-31-2016
2047	ALDICARB	531.1	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2066	3-HYDROXYCARBOFURAN	531.1	Y	MRL	1 UG/L			
2105	2,4-D	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2110	2,4,5-TP	515.3	Y	MRL	1 UG/L		01-01-2014	12-31-2016
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2326	PENTACHLOROPHENOL	515.3	Y	MRL	0.4 UG/L		01-01-2014	12-31-2016
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016

2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2440	DICAMBA	515.3	Y	MRL	0.3 UG/L			
2931	1,2-DIBROMO-3-CHLOROPROPANE	504.1	Y	MRL	0.02 UG/L		01-01-2014	12-31-2016
2946	ETHYLENE DIBROMIDE	504.1	Y	MRL	0.01 UG/L		01-01-2014	12-31-2016
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L			
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2016

**Total Number of Records Fetched = 59**

# Drinking Water Branch

## Chem/Rad Sample Results

[Return Links](#)

[Chem/Rad Samples](#)

[Analyte List](#)

[Water System Detail](#)

[Water Systems](#)

[Water System Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	4012973-01	<b>Collection Date :</b>	01-16-2014

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
1005	ARSENIC	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
1010	BARIUM	200.8			0	31 UG/L	01-01-2014	12-31-2016
1015	CADMIUM	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
1020	CHROMIUM	200.8	Y	MRL	4 UG/L		01-01-2014	12-31-2016
1024	CYANIDE	4500CN-C	Y	MRL	0.2 MG/L		01-01-2011	12-31-2019
1025	FLUORIDE	4500F-C			0	0.499 MG/L	01-01-2014	12-31-2016
1028	IRON	200.7			0	0.55 MG/L	01-01-2014	12-31-2016
1032	MANGANESE	200.8			0	2.5 UG/L	01-01-2014	12-31-2016
1035	MERCURY	200.8	Y	MRL	0.2 UG/L		01-01-2014	12-31-2016
1036	NICKEL	200.8			0	5.1 UG/L	01-01-2014	12-31-2016
1045	SELENIUM	200.8	Y	MRL	5 UG/L		01-01-2014	12-31-2016
1052	SODIUM	200.7			0	7.2 MG/L	01-01-2014	12-31-2016
1055	SULFATE	300.0			0	12 MG/L	01-01-2014	12-31-2016
1074	ANTIMONY, TOTAL	200.8	Y	MRL	3 UG/L		01-01-2014	12-31-2016
1075	BERYLLIUM, TOTAL	200.8	Y	MRL	1 UG/L		01-01-2014	12-31-2016
1085	THALLIUM, TOTAL	200.8	Y	MRL	2 UG/L		01-01-2014	12-31-2016
1095	ZINC	200.8			0	64 UG/L	01-01-2014	12-31-2016
2251	METHYL TERT-BUTYL ETHER	524.2	Y	MRL	0.5 UG/L			
2378	1,2,4-TRICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2380	CIS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2955	XYLENES, TOTAL	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2964	DICHLOROMETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2968	O-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2969	P-DICHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2976	VINYL CHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2977	1,1-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2979	TRANS-1,2-DICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2980	1,2-DICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2981	1,1,1-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2982	CARBON TETRACHLORIDE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2983	1,2-DICHLOROPROPANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2984	TRICHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2985	1,1,2-TRICHLOROETHANE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2987	TETRACHLOROETHYLENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019

2989	CHLOROBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2990	BENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2991	TOLUENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2992	ETHYLBENZENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019
2996	STYRENE	524.2	Y	MRL	0.5 UG/L		01-01-2014	12-31-2019

**Total Number of Records Fetched = 39**

# Drinking Water Branch

## Chem/Rad Sample Results

### Return Links

[Chem/Rad  
Samples](#)

[Analyte List](#)

[Water System  
Detail](#)

[Water Systems](#)

[Water System  
Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	EA00610-01	<b>Collection Date :</b>	01-03-2021

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
4010	COMBINED RADIUM (-226 & -228)	null	Y	MRL	0.649 PCI/L		01-01-2020	12-31-2025
4020	RADIUM-226	903.1	Y	MRL	0.649 PCI/L		01-01-2020	12-31-2025
4030	RADIUM-228	904.0	Y	MRL	0.591 PCI/L		01-01-2020	12-31-2025
4109	GROSS ALPHA PARTICLE ACTIVITY	900.0	Y	MRL	2.95 PCI/L		01-01-2020	12-31-2025

**Total Number of Records Fetched = 4**

# Drinking Water Branch

## Chem/Rad Sample Results

### Return Links

[Chem/Rad  
Samples](#)

[Analyte List](#)

[Water System  
Detail](#)

[Water Systems](#)

[Water System  
Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	30138537001	<b>Collection Date :</b>	01-07-2015

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
4010	COMBINED RADIUM (-226 & -228)	null	null	MRL	null null	1.60 PCI/L	01-01-2014	12-31-2019
4020	RADIUM-226	903.1	N	MRL	0.167 PCI/L	1.60 PCI/L	01-01-2014	12-31-2019
4030	RADIUM-228	904.0	Y	MRL	0.653 PCI/L		01-01-2014	12-31-2019
4109	GROSS ALPHA PARTICLE ACTIVITY	900	N	MRL	2.05 PCI/L	2.97 PCI/L	01-01-2014	12-31-2019

**Total Number of Records Fetched = 4**



# Drinking Water Branch

## Chem/Rad Sample Results

### Return Links

[Chem/Rad  
Samples](#)

[Analyte List](#)

[Water System  
Detail](#)

[Water Systems](#)

[Water System  
Search](#)

[County Map](#)

[Glossary](#)

<b>Water System No. :</b>	IL1775050	<b>Federal Type :</b>	C
<b>Water System Name :</b>	PRAIRIE PATH WATER COMPANY-NORTHERN HILL	<b>State Type :</b>	C
<b>Principal County Served :</b>	STEPHENSON	<b>Primary Source :</b>	GW
<b>Status :</b>	A	<b>Activity Date :</b>	01-01-1976
<b>Lab Sample No. :</b>	30131410001	<b>Collection Date :</b>	10-02-2014

This list displays sample/results of all non-microbial analytes (TSAANLYT.TYPE\_CODE <> MOR) associated to the selected sample. Results for Microbial Analytes are not included.

Analyte Code	Analyte Name	Method Code	Less than Indicator	Level Type	Reporting Level	Concentration level	Monitoring Period Begin Date	Monitoring Period End Date
4010	COMBINED RADIUM (-226 & -228)	null	null	MRL	null null	2.44 PCI/L	01-01-2014	12-31-2016
4020	RADIUM-226	903.1	N	MRL	0.555 PCI/L	1.49 PCI/L	01-01-2014	12-31-2016
4030	RADIUM-228	904.0	N	MRL	0.661 PCI/L	0.945 PCI/L	01-01-2014	12-31-2016
4109	GROSS ALPHA PARTICLE ACTIVITY	900.0	N	MRL	1.93 PCI/L	2.05 PCI/L	01-01-2014	12-31-2016

**Total Number of Records Fetched = 4**